

AIRIUS STVS1 SPEED CONTROLLER - Ideal for BMS and Fire System Integration

The STVS1 series of transformer fan speed controllers regulate the rotational speed of single-phase voltage controllable motors in five steps by varying the output voltage according to an 0—10 VDC analogue input signal. They are equipped with autotransformer(s) and feature TK monitoring for thermal motor protection.



AIRIUS MODEL	10	15	25	45/PS-4	45/PS-2	50/PS-4	60/PS-4
NO. OF UNITS	67	53	25	20	6	11	6

Key Features

- Analogue input signal (0—10 VDC) galvanically isolated
- TK monitoring for thermal motor protection
- 5 switching levels according to the input signal
- LED status indication
- +12 VDC output (e.g. as supply for MTP-X10K potentiometer from Sentera)

Technical Specifications

Supply Voltage	230 VAC / 50—60 Hz	
Control signal input	0—10 VDC	
Output	12 VDC / I _{max} 50 mA	
Unregulated output	230 VAC (max. 2 A)	
Switching levels	Up	2; 4; 6; 8; 9,5 VDC
	Down	Up level — 0,2 VDC
Enclosure	Plastic (R-ABS, UL94-V0, grey RAL 7035) or sheet steel (RAL 7035, polyester powder coating), depending on the product version	
Protection standard	IP54 (according to EN 60529)	
Ambient conditions	Temperature	-20—35 °C
	Rel. humidity	5—95 % rH (non-condensing)







Article Codes

Article code	Rated max. current [A]	Fuse [A]
STVS1-50L22	5,0	(5*20 mm) T-8,0 A-H

Area of Use

- Fan speed control of voltage controllable motors (pumps and fans) in ventilation systems
- For indoor use only

Voltage

0—10 VDC orexternal potentiometerpositions (MTVor MTP)*	0	-	1	2	3	4	5
Wires		-					
Regulated output [VAC]							
Voltages***	0	80**	110	140	170	190	230
Unregulated output [VAC]							
L1	0	230	230	230	230	230	230

* See the operational diagram on the next page for the corresponding voltages.

** Available but not connected.

*** If more than 5 output voltages are available, it is possible to adjust the 5 steps by changing the internal wiring.

Wiring and connections

L	Power supply, phase (230 VAC / 50—60 Hz)
N	Power supply, neutral
Pe	Earth terminal
Pe	Earth terminal
L1	Unregulated output, line
N1	Unregulated output, neutral
N1	Regulated output to motor, neutral
U	Regulated output to motor, line
TK	Input - TK monitoring for thermal motor protection
TK	
0V	Ground
+12V*	Output 12 VDC / I _{max} 50 mA
+V*	Digital output 12 VDC / I _{max} 50 mA (0 VDC = TK fault; 12 VDC = normal operation)
V/C	Input U: 0—10 VDC

*Note: The total output current for both outputs (+12V and +V) must not exceed 100 mA!


Airius Europe Ltd

Holwell Farm, Cranborne
Dorset BH21 5Q - UK

www.airius.co.uk

+44 (0)1202 554200


Get In Touch

 Call: 0845 6880112
 Email: info@adremit.co.uk

Our Address

Puravent, Adremit Limited, Unit 5a, Commercial Yard,
Settle, North Yorkshire, BD24 9RH

DIMENSIONS

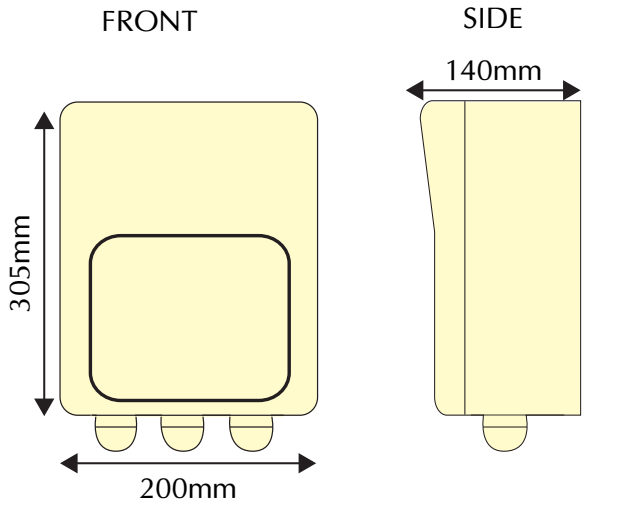

SPEED CONTROLLER COMPONENTS





**SPEED CONTROLLER
(FULLY ASSEMBLED)**



**4 x SCREWS AND WALL
PLUGS FOR WALL MOUNTING**

WIRING DIAGRAM

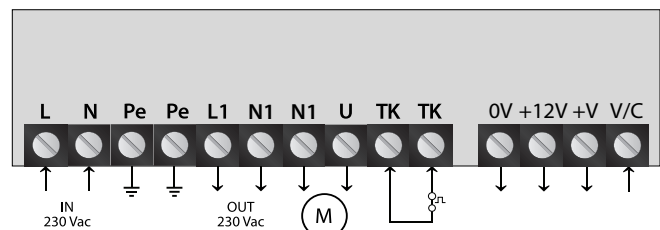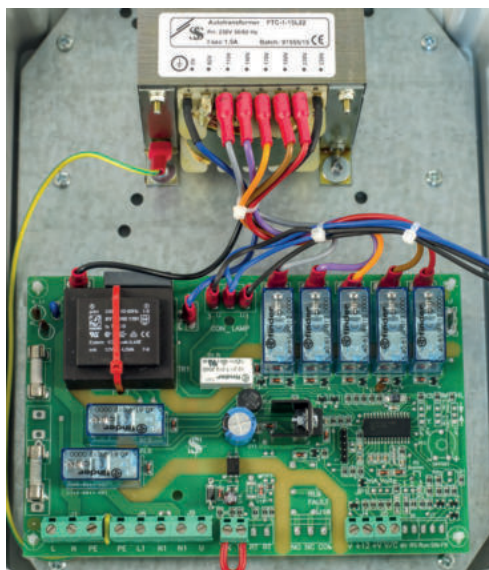

Standards

- Low Voltage Directive 2014/35/EC
- EMC Directive 2014/30/EC: EN 61326
- WEEE Directive 2012/19/EC
- RoHS Directive 2011/65/EC

Mounting

The controllers are to be mounted on a smooth surface. Connect voltage supply, motor(s) and earth as shown in the scheme with cables of the proper diameter. On the mains side, a safety switch with recommend pre-fuses has to be installed.

Transport and Stock Keeping

Avoid shocks and extreme conditions, stock in original packaging.

Warranty


Two years from delivery date against defects in manufacturing. Any modifications or alterations to the product relieve the manufacturer of all responsibility. The manufacturer bears no responsibility for any misprints or mistakes in this data, and modifications or improvements to the product can be made at any time after date of publication.

Maintenance

In normal conditions the controllers are maintenance-free. If soiled clean with dry or dampish cloth. In case of heavy pollution clean with a non-aggressive product. In these circumstances the controller should be disconnected from the mains. Pay attention that no fluids enter the controller. Only reconnect the controller to the mains when it is completely dry.

Motor Protection

It is always recommended to install a proper motor protection device.

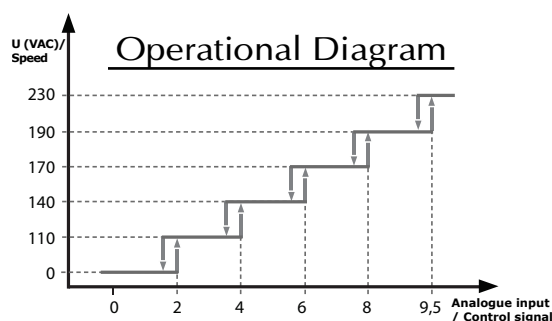

Airius Europe Ltd

Holwell Farm, Cranborne
Dorset BH21 5Q - UK

www.airius.co.uk

+44 (0)1202 554200

Get In Touch

Call: 0845 6880112
Email: info@adremit.co.uk

Our Address

Puravent, Adremit Limited, Unit 5a, Commercial Yard,
Settle, North Yorkshire, BD24 9RH