



SYSTEMAIR-E CO2 SENSOR

Item no. 14904

Document type: **Product card**
 Document date: **2019-06-19**
 Generated by: **Systemair Online Catalogue**

Description

The Systemair-E CO2 sensors are used mainly for demand-controlled ventilation to prevent energy losses from over-ventilation while maintaining indoor air quality

Wall mount sensors are used to control a specific area such as a conference room, classroom, meeting hall, etc. The Systemair-E series are easy to install and have a clean, modern look that suits most indoor environments



Technical parameters

Voltage	24 V
Frequency	50/60 Hz
Power consumption	0,7W
Permitted range for ambient temperature	0-50 °C
Permitted relative humidity, non condensating	0-99 %RH
Working range	0...2000 ppm
Enclosure class	50


Get In Touch

 Call: [0845 6880112](tel:08456880112)
 Email: info@adremit.co.uk

Our Address

Puravent, Adremit Limited, Unit 5a, Commercial Yard,
 Settle, North Yorkshire, BD24 9RH

Dimensions

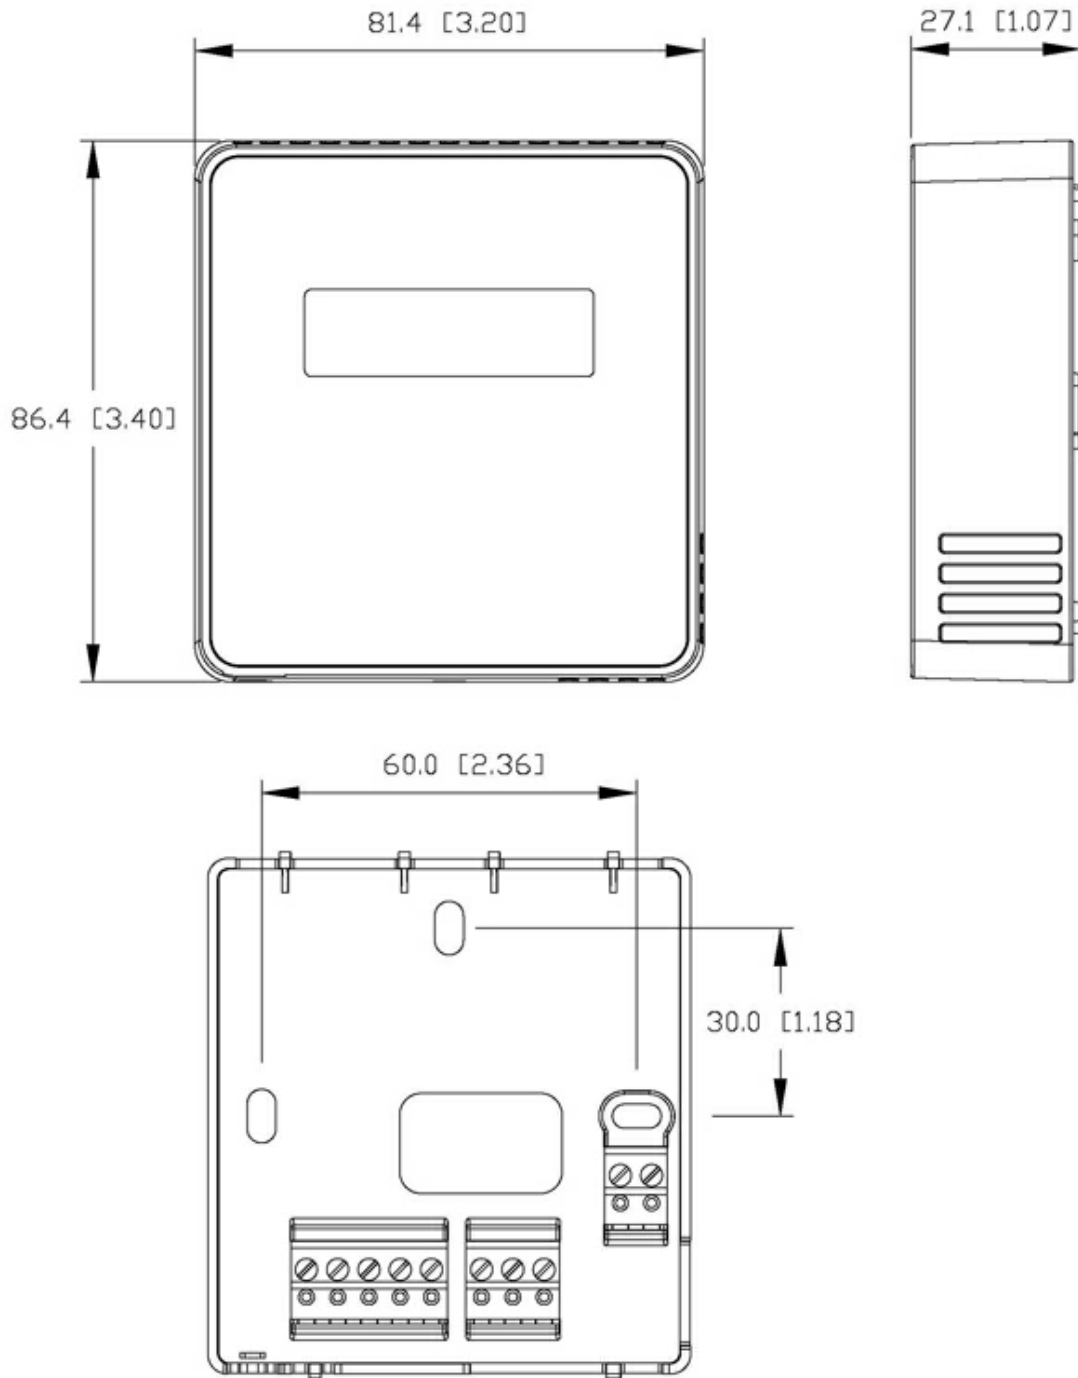



Name: **SYSTEMAIR-E CO2 SENSOR** | Item no.: **14904**

Document type: **Product card** | Document date: **2019-06-19** | Generated by: **Online catalogue**

2 / 3


Get In Touch

 **Call:** [0845 6880112](tel:08456880112)
 **Email:** info@adremit.co.uk


Our Address

Puravent, Adremit Limited, Unit 5a, Commercial Yard,
Settle, North Yorkshire, BD24 9RH

Wiring

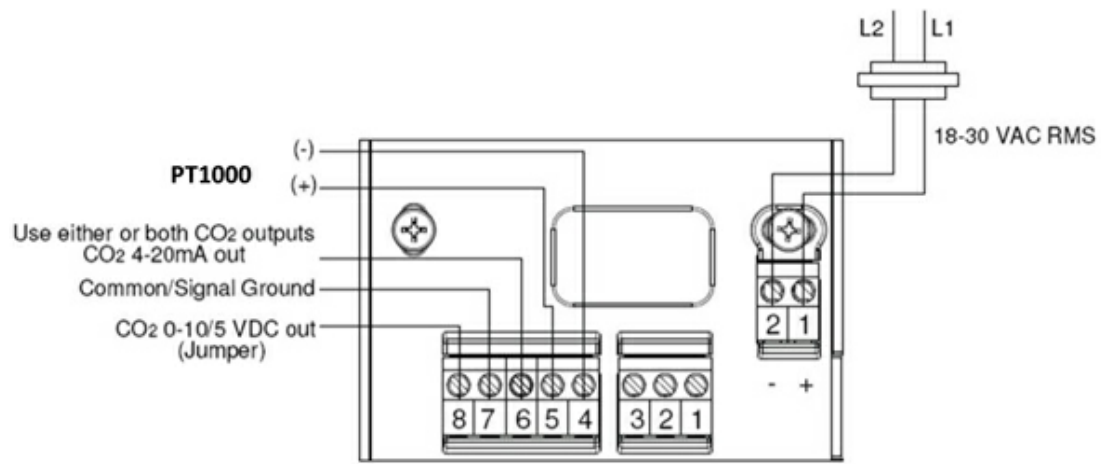

Documentation

 [Systemair-E Installation Manual.pdf](#) (389,06kB)

Specification text

Name: **SYSTEMAIR-E CO2 SENSOR** | Item no.: **14904**

Document type: **Product card** | Document date: **2019-06-19** | Generated by: **Online catalogue**

3 / 3

Get In Touch



Call: [0845 6880112](tel:08456880112)



Email: info@adremit.co.uk

Our Address

Puravent, Adremit Limited, Unit 5a, Commercial Yard,
Settle, North Yorkshire, BD24 9RH